





School Name: Lake Elmo Elementary (LE) Dates: 5/4/2018, 5/8/2018, 9/18/2018, 11/2/2018								
Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler	Lead Result 5/4/2018 & 5/8/2018 (ppb)	Lead Result 9/18/2018 (ppb)	Lead Result 11/2/2018 (ppb)	Lead Result - 30 Sec Flush - 11/2/2018 (ppb)
First Floor	-	Kitchen - Southwall	1	S	2.9	-	-	-
First Floor	-	Kitchen - Southside of Center Station	2	S	2	-	-	-
First Floor	-	Kitchen - Northside of Center Station	3	S	2.7	-	-	-
First Floor	-	Kitchen - Northwall	4	K	28.4	missed	21	1.8
First Floor	-	Kitchen	5	S	15.6	-	-	-
First Floor	-	Kitchen	6	S	9.8	-	-	-
First Floor	-	Kitchen	7	S	4.5	-	-	-
First Floor	-	Kitchen	8	S	5.8	-	-	-
First Floor	-	202 Hallway	9	WC	ND	-	-	-
First Floor	-	202 Hallway	10	WC	ND	-	-	-
First Floor	-	202 Hallway	11	BF	ND	-	-	-
First Floor	120A	Classroom	12	S	4.7	-	-	-
First Floor	106	Office	13	S	2.8	-	-	-
First Floor	131	Classroom	14	S	4.4	-	-	-
First Floor	132	Classroom	15	S	ND	-	-	-
First Floor	605	Classroom	16	S	21.5	2.5	2.8	1.5
First Floor	607	Classroom	17	S	14.5	-	-	-
First Floor	609	Classroom	18	S	104	6.6	15.6	2.4
First Floor	604	Classroom	19	S	7.2	-	-	-
First Floor	606	Classroom	20	S	25.1	5.3	7.5	ND
First Floor	608	Classroom	21	S	ND	-	-	-
First Floor	502	Classroom	22	S	2	-	-	-
First Floor	502	Classroom	23	DF	10.7	-	-	-
First Floor	503	Classroom	24	S	5.1	-	-	-
First Floor	503	Classroom	25	DF	ND	-	-	-
First Floor	504	Classroom	26	S	2	-	-	-
First Floor	505	Classroom	27	S	3.1	-	-	-
First Floor	505	Classroom	28	DF	ND	-	-	-
First Floor	506	Classroom	29	S	6.1	-	-	-
First Floor	507	Classroom	30	S	9.7	-	-	-
First Floor	508	Classroom	31	S	5.4	-	-	-
First Floor	509	Classroom	32	S	10.7	-	-	-
First Floor	510	Classroom	33	S	3.3	-	-	-
First Floor	511	Classroom	34	S	ND	-	-	-
First Floor	-	Hallway 303	35	WC	ND	-	-	-
First Floor	-	Hallway 303	36	BF	ND	-	-	-
First Floor	-	Hallway 500	37	WC	ND	-	-	-
First Floor	-	Hallway 500	38	BF	ND	-	-	-
First Floor	406/408	Classroom	39	S	ND	-	-	-
First Floor	409	Classroom	40	S	4.3	-	-	-

School Name: Lake Elmo Elementary (LE) Dates: 5/4/2018, 5/8/2018, 9/18/2018, 11/2/2018								
Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler	Lead Result 5/4/2018 & 5/8/2018 (ppb)	Lead Result 9/18/2018 (ppb)	Lead Result 11/2/2018 (ppb)	Lead Result - 30 Sec Flush - 11/2/2018 (ppb)
First Floor	409	Classroom	41	S	3.7	-	-	-
First Floor	-	Special Ed	42	S	5.2	-	-	-
First Floor	412	Classroom	43	S	ND	-	-	-
First Floor	412	Classroom	44	S	ND	-	-	-
First Floor	414	Classroom	45	S	ND	-	-	-
First Floor	414	Classroom	46	S	ND	-	-	-
First Floor	415	Classroom	47	S	3	-	-	-
First Floor	415	Classroom	48	S	ND	-	-	-
First Floor	-	Hallway 401	49	WC	ND	-	-	-
First Floor	416	Classroom	50	S	24.6	15.3	3.7	ND
First Floor	310	Media Center	51	S	261	60.9	49.9	3.6
First Floor	210	Classroom	52	S	4.8	-	-	-
First Floor	202	Classroom	53	S	5.1	-	-	-
First Floor	204	Classroom	54	S	12.1	-	-	-
First Floor	206	Classroom	55	S	8.3	-	-	-
First Floor	208	Classroom	56	S	2.1	-	-	-
First Floor	-	Hallway 220	57	WC	ND	-	-	-
First Floor	-	Hallway 220	58	BF	ND	-	-	-
First Floor	214	Classroom	59	S	7.6	-	-	-
First Floor	216	Classroom	60	S	12.2	-	-	-
First Floor	219	Classroom	61	S	8.5	-	-	-
First Floor	217	Classroom	62	S	18.4	-	-	-
First Floor	211	Classroom	63	S	ND	-	-	-
First Floor	209	Classroom	64	S	3.5	-	-	-
First Floor	207	Classroom	65	S	7.7	-	-	-
Second Floor	231	Classroom	66	S	7.8	-	-	-
Second Floor	232	Classroom	67	S	2.6	-	-	-

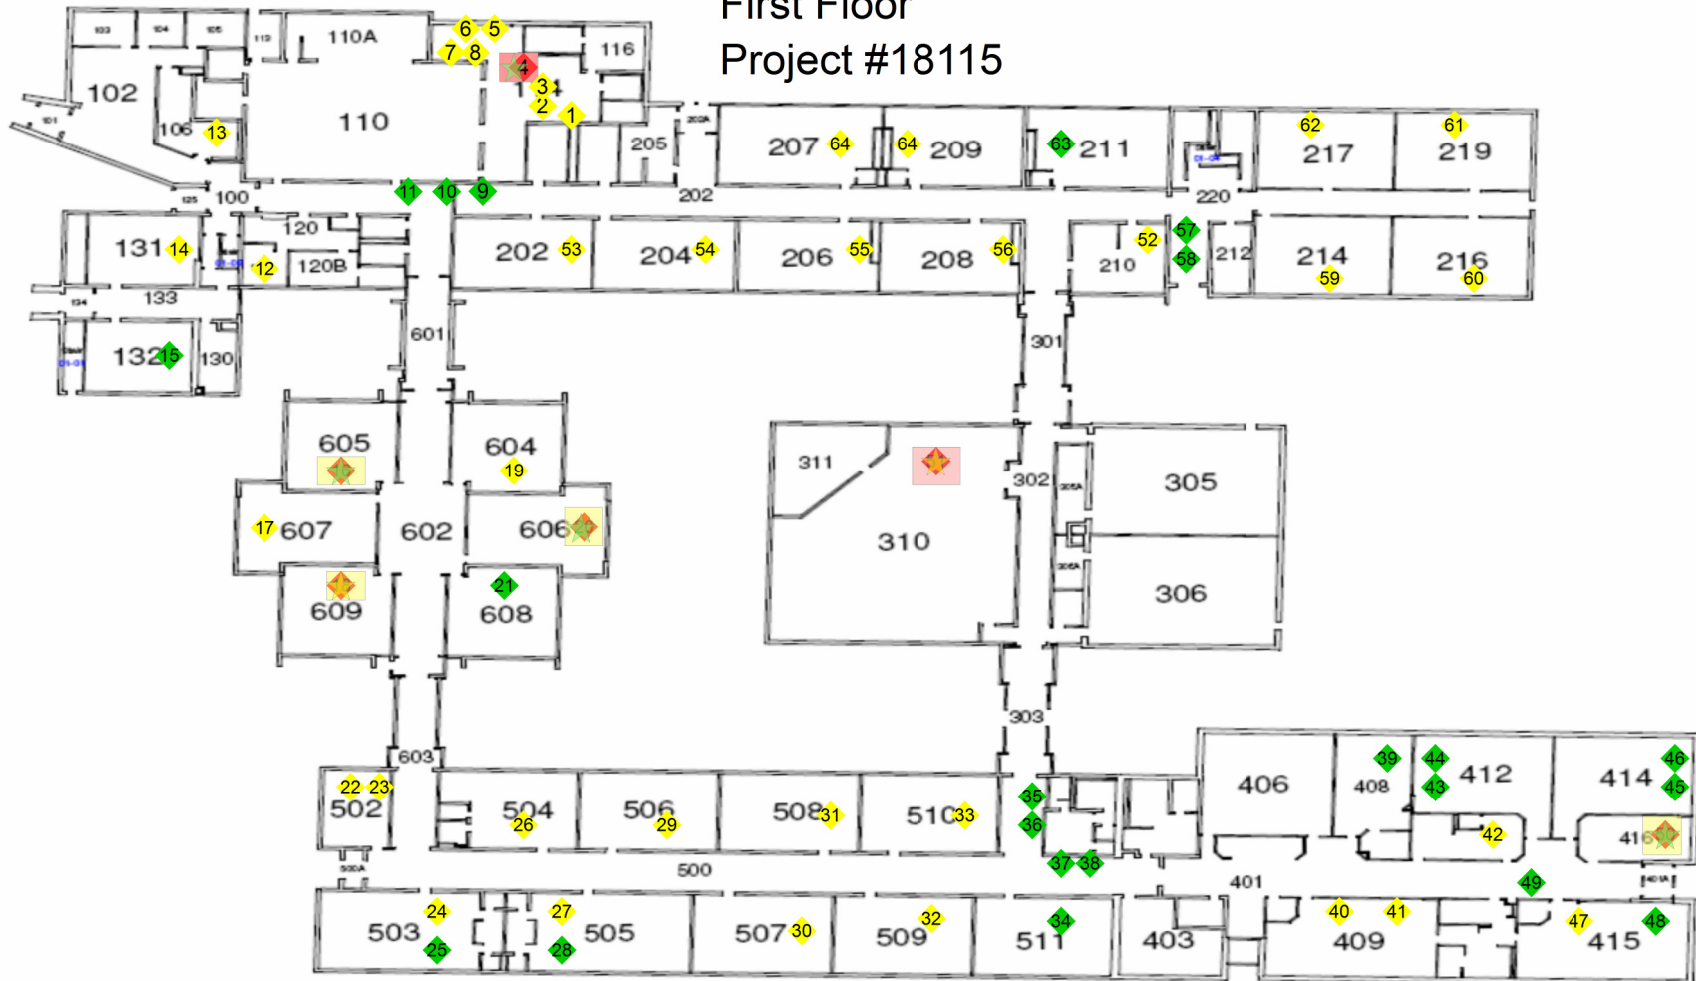


Lake Elmo Elementary
Lead in Drinking Water
First Floor
Project #18115






First Draw Sampling (May 2018)


-  Lead < 2 ppb
-  2 ppb <= Lead <= 20 ppb
-  Lead > 20 ppb

First Draw Sampling (Sept 2018)

-  Lead < 2 ppb
-  2 ppb <= Lead <= 20 ppb
-  Lead > 20 ppb

Flush Sampling (Nov 2018)




-  Lead < 2 ppb
-  2 ppb <= Lead <= 20 ppb
-  Lead > 20 ppb





Lake Elmo Elementary
Lead in Drinking Water
Second Floor
Project #18115

First Draw Sampling (May 2018)

-  Lead < 2 ppb
-  2 ppb <= Lead <= 20 ppb
-  Lead > 20 ppb

